



SIDE VIEW
1 : 22

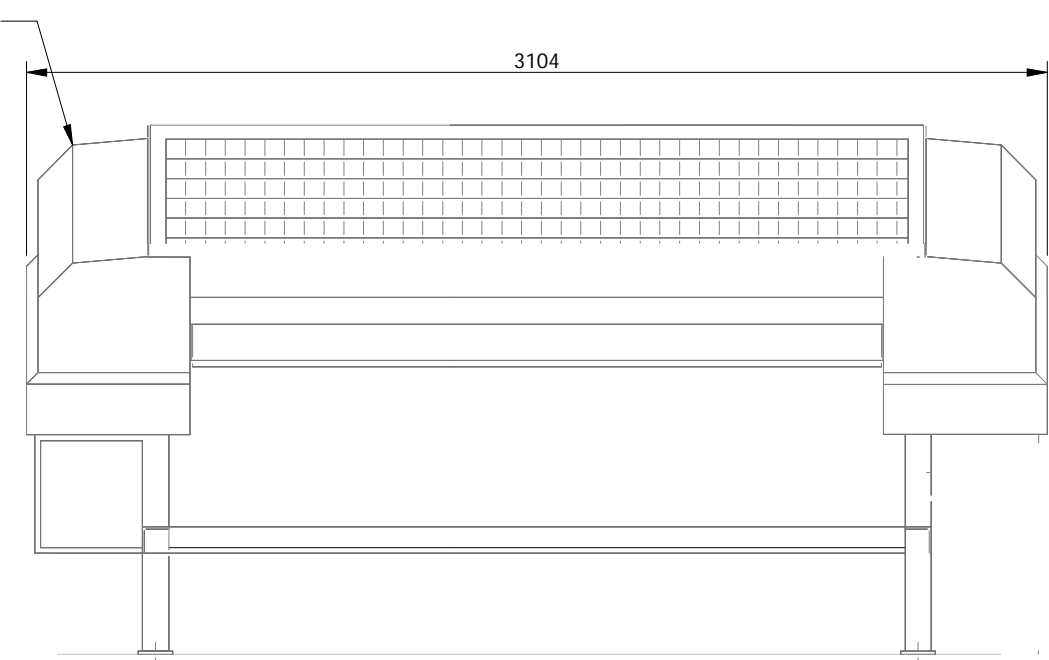

FRONT VIEW
1 : 22

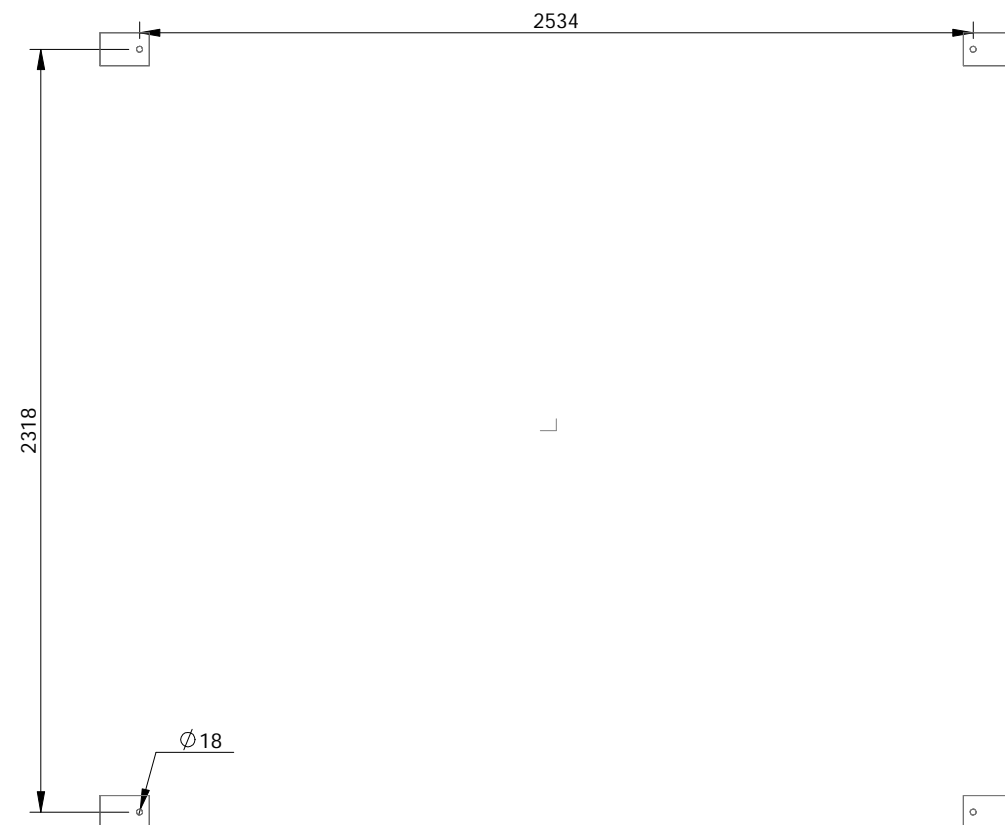

PLAN VIEW
1 : 22
MOUNTING HOLE POSITIONS ONLY

NOTES :

- 1) INLET FLOW IS EITHER GRAVITY FED OR PUMPED TO HEADER TANK (VIA WASTE WATER INLET) AND FILTRATE FLOW TO COLLECTION POINT IS BY GRAVITY.
 - 2) A SELF DRAINING SKIP (OR SUITABLE MECHANICAL EQUIVALENT) IS REQUIRED FOR "SPADE-ABLE" SOLIDS COLLECTION AND A MIST COVER (OR HOOD) IS REQUIRED AT FRONT OR UNIT.
 - 3) ALL ANCILLARY WORKS (PIPING, SERVICES, SUMP, SHED, SUPPORT SLAB, SOLIDS SKIP, ETC) TO BE SUPPLIED AND INSTALLED BY THE CLIENT.
 - 4) SERVICES REQUIRED TO OPERATE THE FILTER ARE PROVIDED BY THE PUMP CONTROL UNIT (REFER TO INSTALLATION PROFORMA) OUTLET CONNECTIONS
 - 5) SUBFRAME IS PROVIDED BY CLIENT AND MUST INCLUDE PROVISIONS FOR DIRECTING THE FILTRATE TO THE COLLECTION SUMP (OR DRAIN).
 - 6) GUARDING OF FILTER MECHANISM IS STRONGLY RECOMMENDED TO ENSURE AGAINST INJURY BY TRAVEL OF THE FILTER MECHANISM CARRIAGE.
 - 7) SECURING THE FILTER MECHANISM TO A RIGID NON-VIBRATIONAL STRUCTURE (OR FOUNDATION) IS RECOMMENDED.
 - 8) WATER FROM DEWATERING SOLIDS COLLECTION SKIP MAY BE DIRECTED EITHER TO FILTRATE OR TO OTHER SUITABLE LOCATION (SUBJECT TO SITE SURVEY).
 - 9) FINAL SPECIFICATIONS ARE BASED ON INDIVIDUAL SITE REQUIREMENTS.
 - 10) UPSTREAM PRETREATMENTS AND INFLUENT BALANCING MAY BE REQUIRED (SUBJECT TO SITE SURVEY).
- FOR FURTHER INFORMATION PLEASE CONTACT YOUR LOCAL BALEEN REPRESENTATIVE.

Disclaimer : This information is copyright and owned by Baleen Filters Pty Ltd. All rights reserved. Details accurate at the time of printing. Baleen Filters Pty Ltd reserves the right to change any of the details.

DRAWN	SER	BALEEN FILTERS PTY LTD	DESCRIPTION	PROJECT
DATE	18/11/03		"USER-INSTALL" FILTER UNIT INSTALLATION PROFORMA	C1
EDITED	SER	PO BOX 1189, NORTH ADELAIDE SA 5006 AUSTRALIA Tel: +61 8 8239 2533 Fax: +61 8 8239 0722 email: info@baleenfilters.com.au	DRG No.	REV
DATE	23/11/03		20W15M	DRAFT