


SIDE VIEW
1 : 15

FRONT VIEW
1 : 15

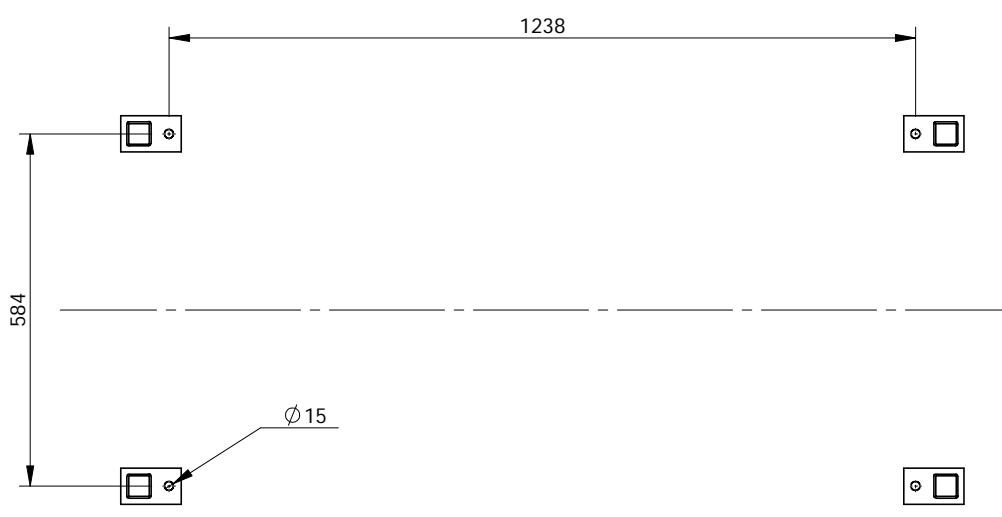

PLAN VIEW
1 : 12
MOUNTING HOLE POSITIONS ONLY

- NOTES :
- 1) INLET FLOW IS EITHER GRAVITY FED OR PUMPED TO HEADER TANK (VIA WASTE WATER INLET) AND FILTRATE FLOW TO COLLECTION POINT IS BY GRAVITY.
 - 2) A SELF DRAINING SKIP (OR SUITABLE MECHANICAL EQUIVALENT) IS REQUIRED FOR "SPADE-ABLE" SOLIDS COLLECTION AND A MIST COVER (OR HOOD) IS REQUIRED AT FRONT OR UNIT.
 - 3) ALL ANCILLARY WORKS (PIPING, SERVICES, SUMP, SHED, SUPPORT SLAB, SOLIDS SKIP, ETC) TO BE SUPPLIED AND INSTALLED BY THE CLIENT.
 - 4) SERVICES REQUIRED TO OPERATE THE FILTER ARE PROVIDED BY THE PUMP CONTROL UNIT (REFER TO INSTALLATION PROFORMA) OUTLET CONNECTIONS
 - 5) SECURING THE FILTER UNIT TO A RIGID NON-VIBRATIONAL STRUCTURE (OR FOUNDATION) IS RECOMMENDED.
 - 6) WATER FROM DEWATERING SOLIDS COLLECTION SKIP MAY BE DIRECTED EITHER TO FILTRATE OR TO OTHER SUITABLE LOCATION (SUBJECT TO SITE SURVEY).
 - 7) FINAL SPECIFICATIONS ARE BASED ON INDIVIDUAL SITE REQUIREMENTS.
 - 8) UPSTREAM PRETREATMENTS AND INFLUENT BALANCING MAY BE REQUIRED (SUBJECT TO SITE SURVEY).
- FOR FURTHER INFORMATION PLEASE CONTACT YOUR LOCAL BALEEN REPRESENTATIVE.

DRAWN SER	BALEEN FILTERS PTY LTD	DESCRIPTION	PROJECT
DATE 21/08/02		COTTAGE FILTER UNIT INSTALLATION PROFORMA	C2
EDITED SER	168 Melbourne Street, North Adelaide SA 5006 AUSTRALIA Tel: +61 8 8239 2422 Fax: +61 8 8239 0722 email: info@baleenfilters.com	DRG No.	REV
DATE 25/04/03		05W05C	FINAL